


REVAMPING

Application: nuclear power station – ENERGY sector

before



after
revamping

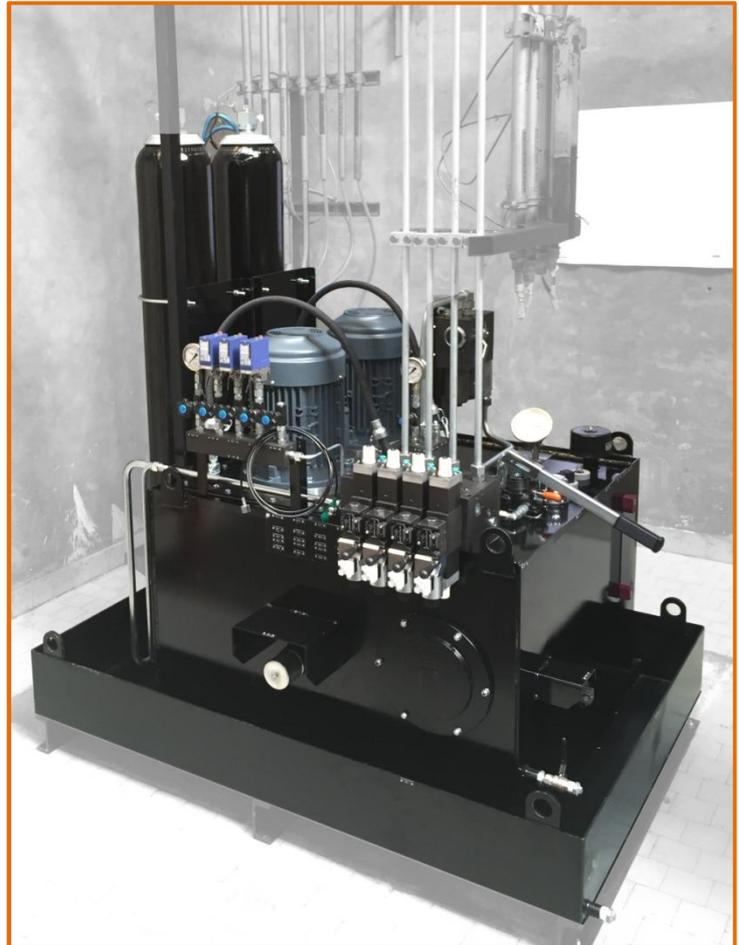

SUPPLY: Total revamping of the power unit for water control

CHARACTERISTICS OF THE SYSTEM:

- Power unit for the control of opening and closure operation of hydraulic butterfly valves
- Redundant motorpump group
- Bank of batteries for emergency operation in absence of power supply
- Adjustment of opening and closure speed of hydraulic butterfly valves
- Possibility to manually operate the power unit in absence of power supply

For more information on this application contact us at: applications@duplomatic.com